



# **Infrared CO2 Sensor Module (Model: TX-Z19E)**

## **User's Manual**

**(Version 1.1)**

**Issue Date. 2023.03.29**

Taiyuan Tengxing sensor technology Co., Ltd

**ISO9001 Certificated Company**

---

**Leading gas sensing solutions supplier in China**

---

# Statement

This manual's copyright belongs to Taiyuan Tengxing sensor technology Co., Ltd. Without the written permission, any part of this manual shall not be copied, translated, stored in database or retrieval system, also can't spread through electronic, copying, record ways.

Thanks for purchasing our product. In order to let customers use it better and reduce the faults caused by misuse, please read the manual carefully and operate it correctly in accordance with the instructions. If users disobey the terms or remove, disassemble, change the components inside of the sensor, we shall not be responsible for the loss.

The specific such as color, appearance, sizes &etc., please in kind prevail.

We are devoting ourselves to products development and technical innovation, so we reserve the right to improve the products without notice. Please confirm it is the valid version before using this manual. At the same time, users' comments on optimized using way are welcome.

Please keep the manual properly, in order to get help if you have questions during the usage in the future.



Taiyuan Tengxing sensor technology Co., Ltd

---

## TX-Z19E NDIR CO2 Module

### Profile

TX-Z19E NDIR infrared gas module is a common type, small size sensor, pins/reversed pins type or terminal type, using non-dispersive infrared (NDIR) principle to detect the existence of CO<sub>2</sub> in the air, with good selectivity, non-oxygen dependent and long life. Built-in temperature compensation; and it has UART output and PWM output. It is developed by the tight integration of mature infrared absorbing gas detection technology, precision optical circuit design and superior circuit design.



### Applications

- \*HVAC refrigeration
- \*Indoor air quality monitoring
- \*Ventilation system
- \*Air cleaner device
- \*Smart home
- \*School

### Main Features

- \*High sensitivity, low power consumption
- \*Good stability
- \*Temperature compensation, excellent linear output
- \*Multiple output modes: UART, PWM
- \*Long lifespan
- \*Anti-water vapor interference, anti-poisoning

**Fig1.Pins/Reversed Pins  
Terminal**

### Main parameters

**Table1.**

Model No.	TX-Z19E
Detection Gas	CO <sub>2</sub>
Working voltage	5.0±0.1V DC
Average current	< 40mA (@5V power supply)
Peak current	125mA (@5V power supply)
Interface level	3.3 V (Compatible with 5V)
Detection Range	400~10000ppm(optional, see table2.)
Output signal	Serial Port (UART) (TTL level 3.3V)
	PWM
Preheat time	1 min
Refresh time	2 s
Response Time	T <sub>90</sub> < 120 s
Working temperature	-10 ~ 50 °C
Working humidity	0 ~ 95% RH (No condensation)
Storage temperature	-20~60 °C
Weight	5 g
Lifespan	> 10 years

## Detection range and accuracy Table2.

Detection Gas	Formula	Detection Range	Resolution	Accuracy
Carbon Dioxide	CO <sub>2</sub>	400~2000ppm	1ppm	± (50ppm+5% reading value)
		400~5000ppm		
		400-10000ppm		

## Dimensions (Pins/Reversed pins type) unmarked tolerance is ±0.2


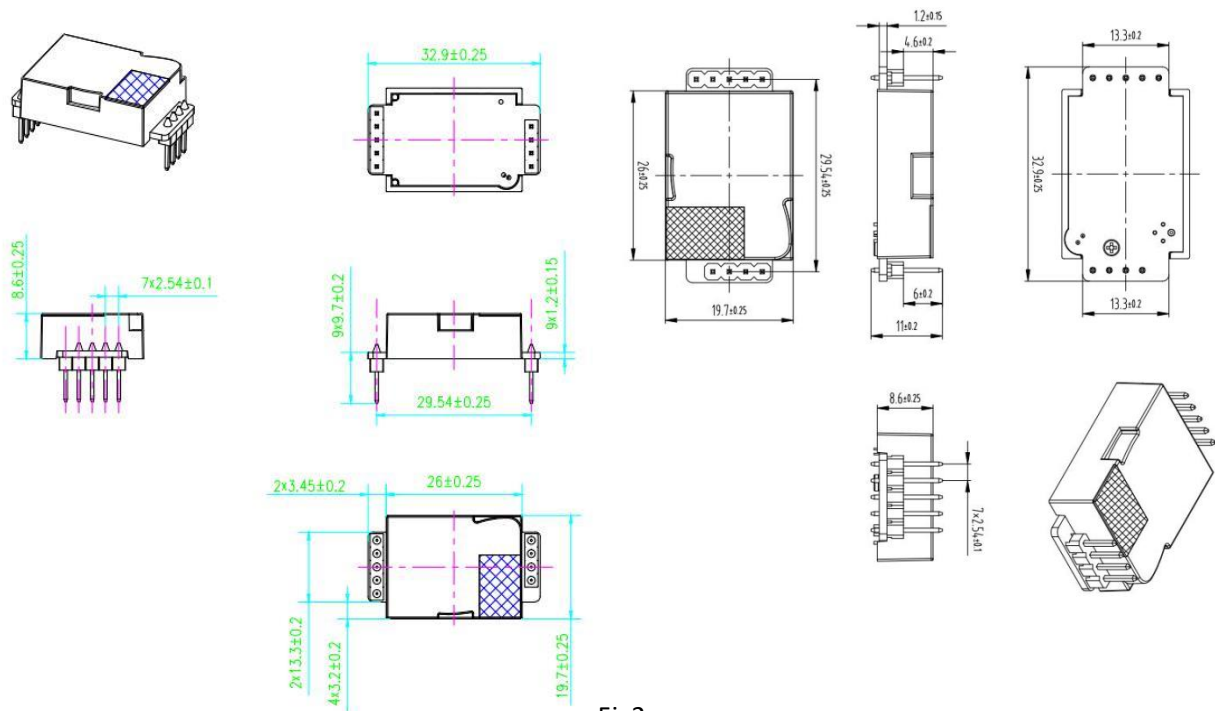



Fig2.

## Pins connection type table3.

Pin	Pin Definition
Vin	Positive pole of power (Vin)
GND	Negative pole of power (GND)
PWM	PWM
Hd	HD(zero point calibration, low level lasting for over 7s is effective)
Rx	UART(RXD)TTL Level data input
Tx	UART(TXD)TTL Level data output

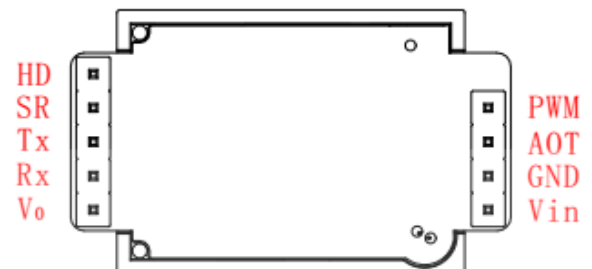


## Dimensions (Terminal type)

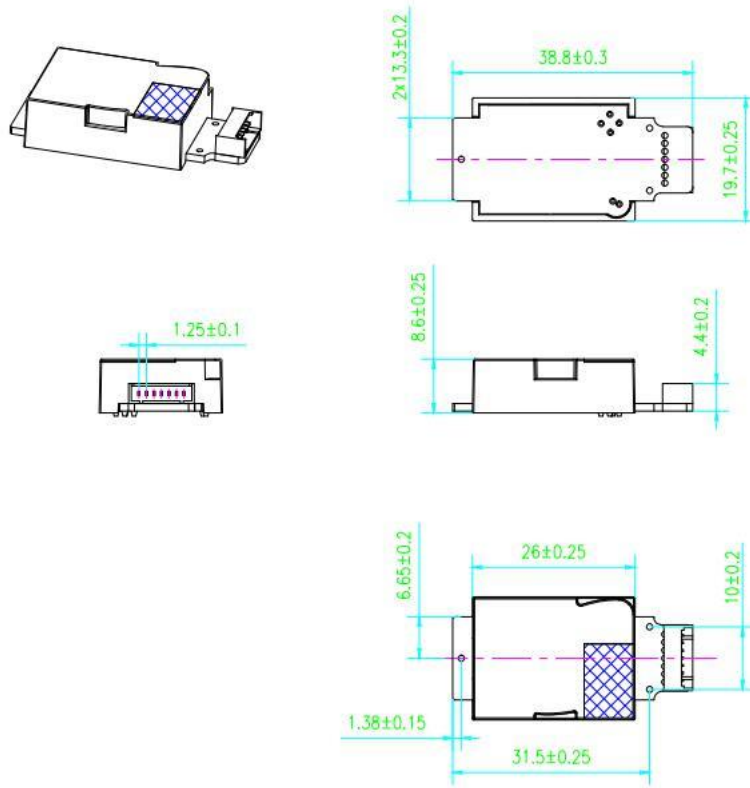

## Terminal connection type

Pin	Terminal Pin Definition
Pin 4	Vin Power In
Pin 3	GND
Pin 2	Reserved
Pin 7	PWM
Pin 1	HD(zero point calibration, low level lasting for over 7s is effective)
Pin 5	UART(RXD) 0~3.3V data input
Pin 6	UART(TXD) 0~3.3V data output

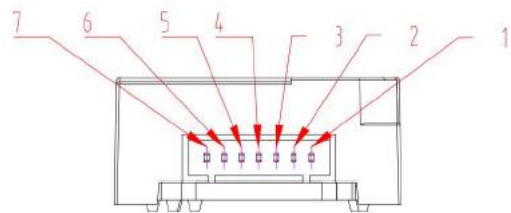

Terminal Connection Version

## Cautions

- Please avoid the pressure of its optical chamber from any direction, during welding, installation, and use.
- When placed in small space, the space should be well ventilated, especially for diffusion window.
- The module should be away from heat, and avoid direct sunlight or other heat radiation.
- The module should be calibrated termly, the suggested period is no longer than 6 months.
- Do not use the sensor in the high dusty environment for long time.

- 
- To ensure the normal work, the power supply must be among  $5.0V \pm 0.1V$  DC rang, the power current must be not less than 150mA. Out of this range, it will result in the failure of the sensor. (The concentration output is low, or the sensor cannot work normally.)
  - During the zero-point calibration procedure by manual or sending command, the sensor must work in stable gas environment (400ppm) for over 20 minutes.
  - Forbid using wave soldering for the sensor.
  - When soldering with soldering iron, set the temperature to be  $(350 \pm 5)^{\circ}\text{C}$ , and soldering time must be within 3 seconds.
  - We suggest customers to use the way of soldering the socket and plugging/pulling the sensors for easier maintenance.